

ITEM 4.2.1 | SPACE ALLOWANCE AND REACH RANGES - WHEELCHAIR PASSAGE WIDTH

The minimum clear width for single wheelchair passage shall be 32 in (815 mm) at a point and 36 in (915 mm) continuously (see Fig. 1 and 24(e)).

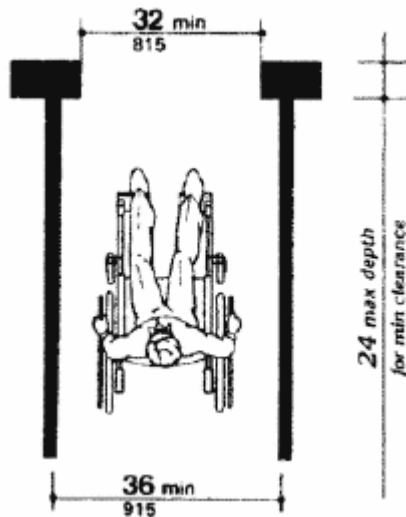


Fig. 1 Minimum Clear Width for Single Wheelchair

(“1991 Standards for Accessible Design”, 28 CFR 36 Appendix D)