

ITEM 4.4.1 | PROTRUDING OBJECTS - GENERAL

Objects projecting from walls (for example, telephones) with their leading edges between 27 in and 80 in (685 mm and 2030 mm) above the finished floor shall protrude no more than 4 in (100 mm) into walks, halls, corridors, passageways, or aisles (see Fig. 8(a)). Objects mounted with their leading edges at or below 27 in (685 mm) above the finished floor may protrude any amount (see Fig. 8(a) and (b)). Free-standing objects mounted on posts or pylons may overhang 12 in (305 mm) maximum from 27 in to 80 in (685 mm to 2030 mm) above the ground or finished floor (see Fig. 8(c) and (d)). Protruding objects shall not reduce the clear width of an accessible route or maneuvering space (see Fig. 8(e)).

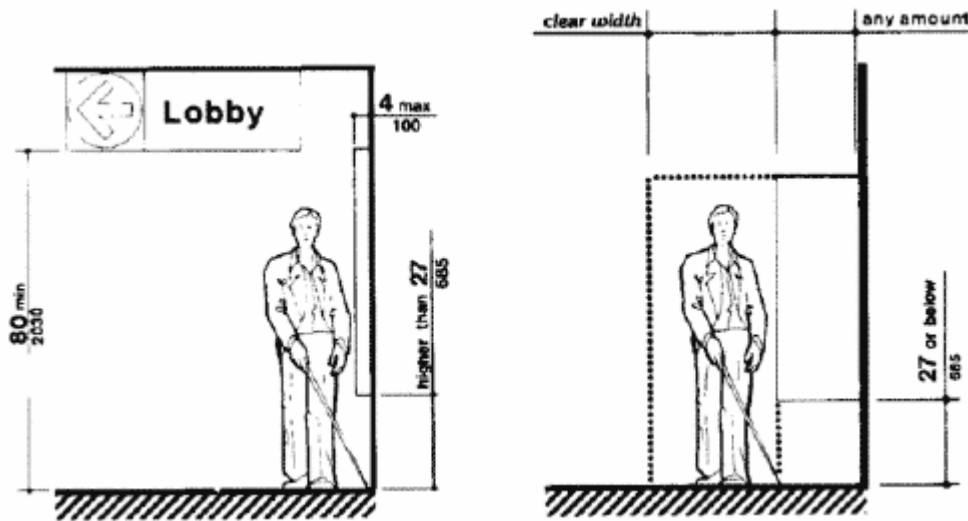


Fig. 8(a) Walking Parallel to a Wall



Fig. 8(b) Walking Perpendicular to a Wall

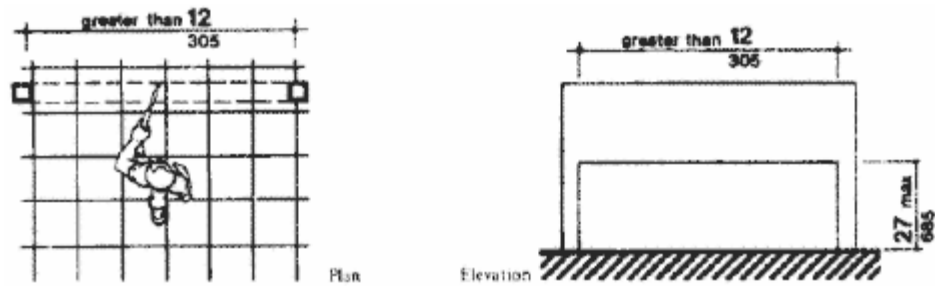


Fig. 8(c) Free-Standing Overhanging Objects

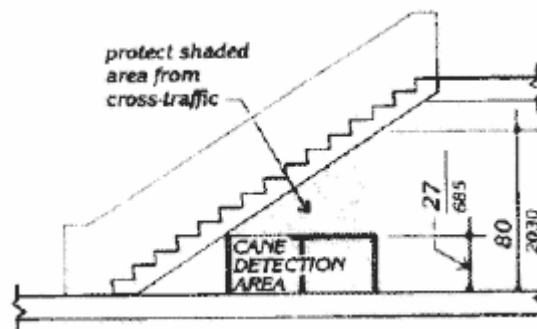


Fig. 8(c-1) Overhead Hazards

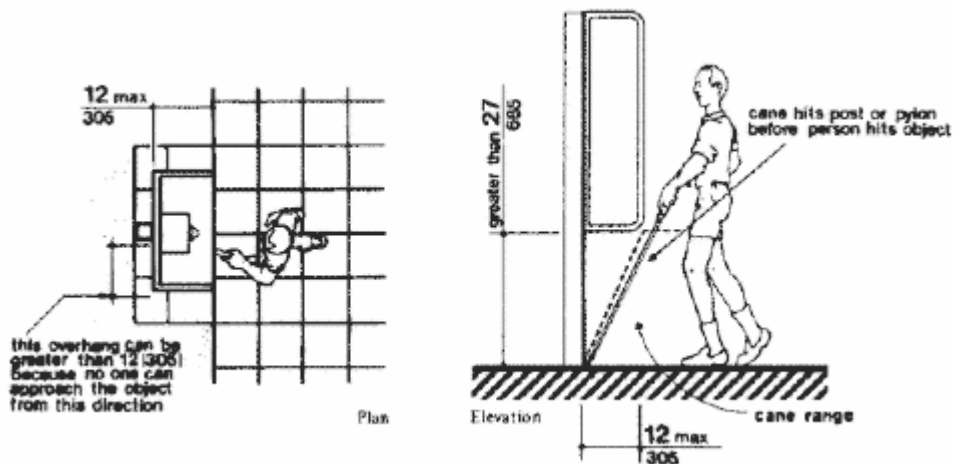


Fig. 8(d) Objects Mounted on Posts or Pylons

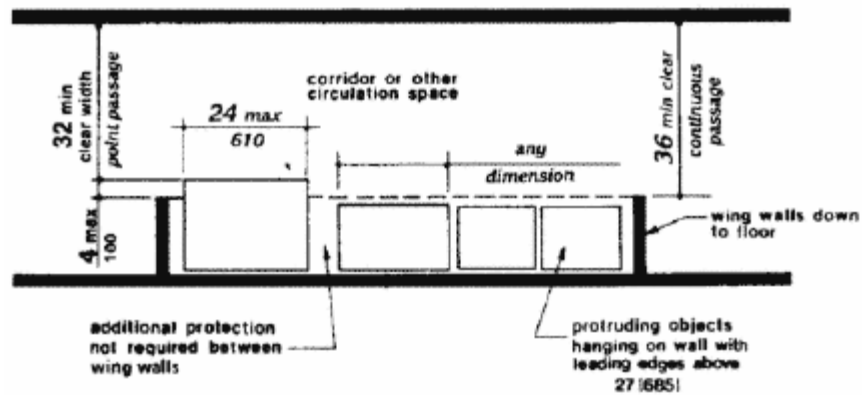


Fig. 8(e) Example of Protection around Wall-Mounted Objects and Measurements of Clear Widths

Fig. 8 Protruding Objects

("1991 Standards for Accessible Design", 28 CFR 36 Appendix D)