

ITEM 4.7.2 | CURB RAMPS - SLOPE

Slopes of curb ramps shall comply with 4.8.2. The slope shall be measured as shown in Fig. 11. Transitions from ramps to walks, gutters, or streets shall be flush and free of abrupt changes. Maximum slopes of adjoining gutters, road surface immediately adjacent to the curb ramp, or accessible route shall not exceed 1:20.

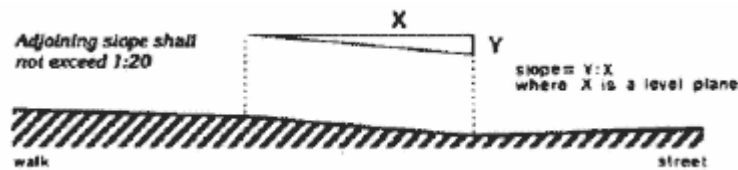


Fig. 11 Measurement of Curb Ramp Slopes

("1991 Standards for Accessible Design", 28 CFR 36 Appendix D)