



ITEM 4.17.3 | TOILET STALLS - SIZE AND ARRANGEMENT

The size and arrangement of the standard toilet stall shall comply with Fig. 30(a). Standard Stall. Standard toilet stalls with a minimum depth of 56 In (1420 mm) (see Fig. 30(a)) shall have wall-mounted water closets. If the depth of a standard toilet stall is increased at least 3 In (75 mm), then a floor-mounted water closet may be used. Arrangements shown for standard toilet stalls may be reversed to allow either a left - or right - hand approach. Additional stalls shall be provided in conformance with 4.22.4.




EXCEPTION: In instances of alteration work where provision of a standard stall (Fig. 30(a)) is technically infeasible or where plumbing code requirements prevent combining existing stalls to provide space, either alternate stall (Fig. 30(b)) may be provided in lieu of the standard stall.

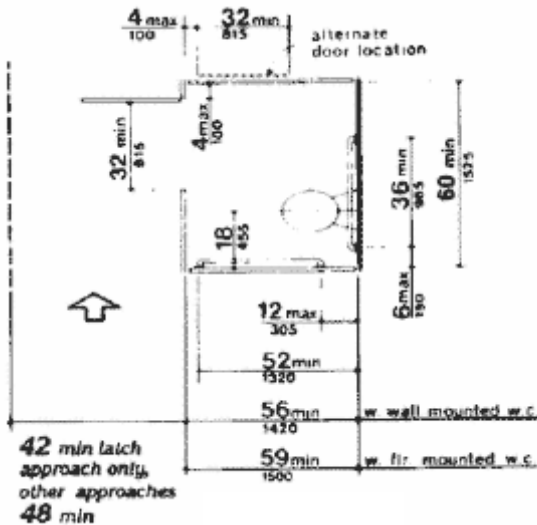

(a)
Standard Stall

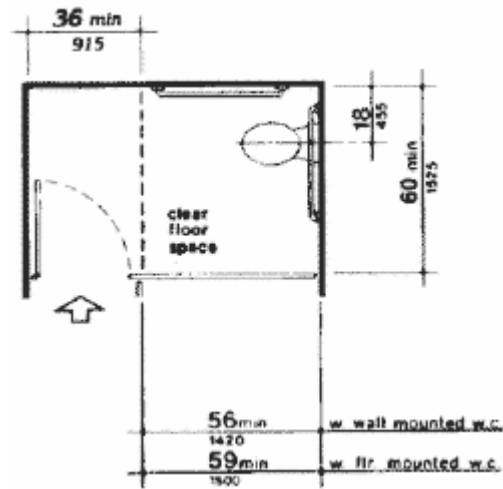

(a-1)
Standard Stall (end of row)



(“1991 Standards for Accessible Design”, 28 CFR 36 Appendix D)